


## HIGH POWER LATCHING RELAY

- 100A Latching Relay
- UC3 capability as per IEC 62052-31:
  - Rated Operational Current (Ie) = 100A
  - Rated Operational Current (Ue) = 240V
- UC3 capability as per IEC 62055-31:
  - Rated Breaking Current (Ic) = 90A
  - Reference Voltage (Un) = 240V
  - Rated Breaking Voltage (Uc) = 276V
- 4kV dielectric strength between coil and contacts
- Auxiliary Contact: 1 Form C
- Outline dimensions: (43.2 x 37.2 x 22.0)mm
- Custom assemblies available with flex wire and/or copper extensions, and/or with integrated shunt
- RoHS compliant materials and process

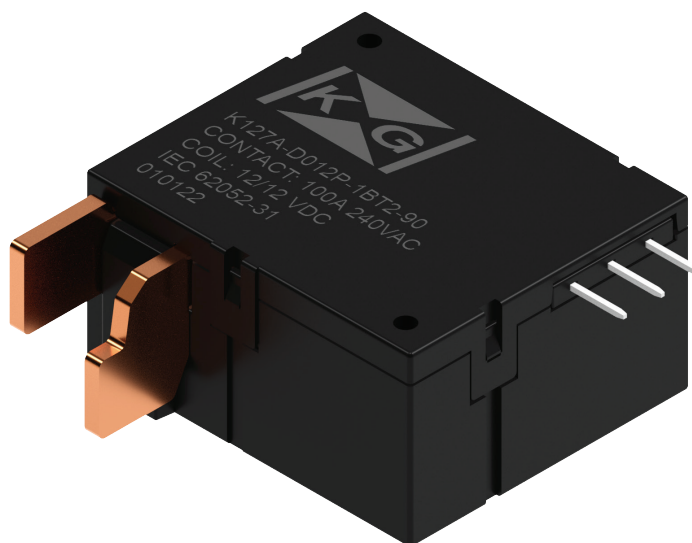

### Contact Data

Rated Load *	100A @ 240V , 90A @ 276V
Contact form	1A or 1B
Contact material	AgSnO <sub>2</sub>
Contact resistance †	0.35mΩ (at 100 A)
Max. switching voltage ‡	276 Vac
Max. carrying current	120 A
Max. switching current §	100 A
Rated switching power	24,840 VA
Set time	≤ 20 ms
Reset time	≤ 20 ms
Electrical endurance	10,000 cycles
Mechanical endurance	100,000 cycles

### Characteristics

Insulation resistance	1,000MΩ (at 500 Vdc)
Dielectric strength:	
Coil to contact	4kVac for 1 min
	12kV 1.2μs/50μs
Across open contacts	2kVac for 1min
Dielectric creepage	8 mm
Ambient temperature	-40°C to +85°C
Ambient humidity	5% - 85% RH
Vibration	1.5 mm (DA) 10 Hz to 55 Hz
Shock resistance:	
Functional **	98 m/s <sup>2</sup>
Survival	980 m/s <sup>2</sup>
Coil termination	PCB or Wire
Unit weight	75g

\* Load at which the relay can pass UC3 as per IEC 62052-31, IEC 62055-31

† Typical value for Initial Contact Resistance: Using a sample quantity of at least 20 units, take the average value from 5 continuous measurements from each sample

‡ Voltage at which the relay can pass electrical endurance testing as per IEC 62055-31

§ Current at which the relay can pass UC3 as per IEC 62052-31

\*\* Unit may change state but is still functional

## Coil Data

	Single Coil (Latching)	Dual Coil (Latching)
Coil Consumption	3W	6W
Pulse Duration	50ms	50ms

## Coil Resistance

( $\Omega \pm 10\%$ ) at 23°C

Nominal Coil Voltage	Min Set/Reset Voltage	Single Coil (Latching)	Dual Coil (Latching)
6Vdc	4.8Vdc	12 $\Omega$	2 x 6 $\Omega$
9Vdc	7.2Vdc	27 $\Omega$	2 x 13.5 $\Omega$
12Vdc	9.6Vdc	48 $\Omega$	2 x 24 $\Omega$
24Vdc	19.2Vdc	192 $\Omega$	2 x 96 $\Omega$
48Vdc	38.4Vdc	768 $\Omega$	2 x 384 $\Omega$

## Ordering Information

**K127** ■ **-** ■ ■ ■ **-** **T** **2** ■ **-90** **-Cxxxx**

Relay Series:

Terminal Type: A: See Drawing  
X: Custom Design<sup>††</sup>

Coil Type: S: Single Coil  
D: Dual Coil

Coil Voltage<sup>‡‡</sup>: 6, 9, 12, 24, 48 Vdc

Polarity: P: Positive  
N: Negative

Contact Form: 1A: Form 1A – Normally open (NO)  
1B: Form 1B – Normally closed (NC)

Contact Material: T: AgSnO<sub>2</sub>

Contact Type: 2: Dual contact

Auxiliary Contact: C: 1 Form C  
Nil: No auxiliary contact

Version: 90: UC3 at 240V Ue, 100A Ie as per IEC 62052-31  
UC3 at 276V Uc, 90A Ic as per IEC 62055-31


Custom Number: Cxxxx: Where xxxx represents a unique number for custom relay terminal designs

<sup>††</sup> For custom designs, please contact KG Technologies. Integrated shunts, flex-wire, copper extension and brass terminals available

<sup>‡‡</sup> Coil voltage should be indicated in three-digit format (6Vdc = 006)


# Dimensional Drawings

(Unit: mm)

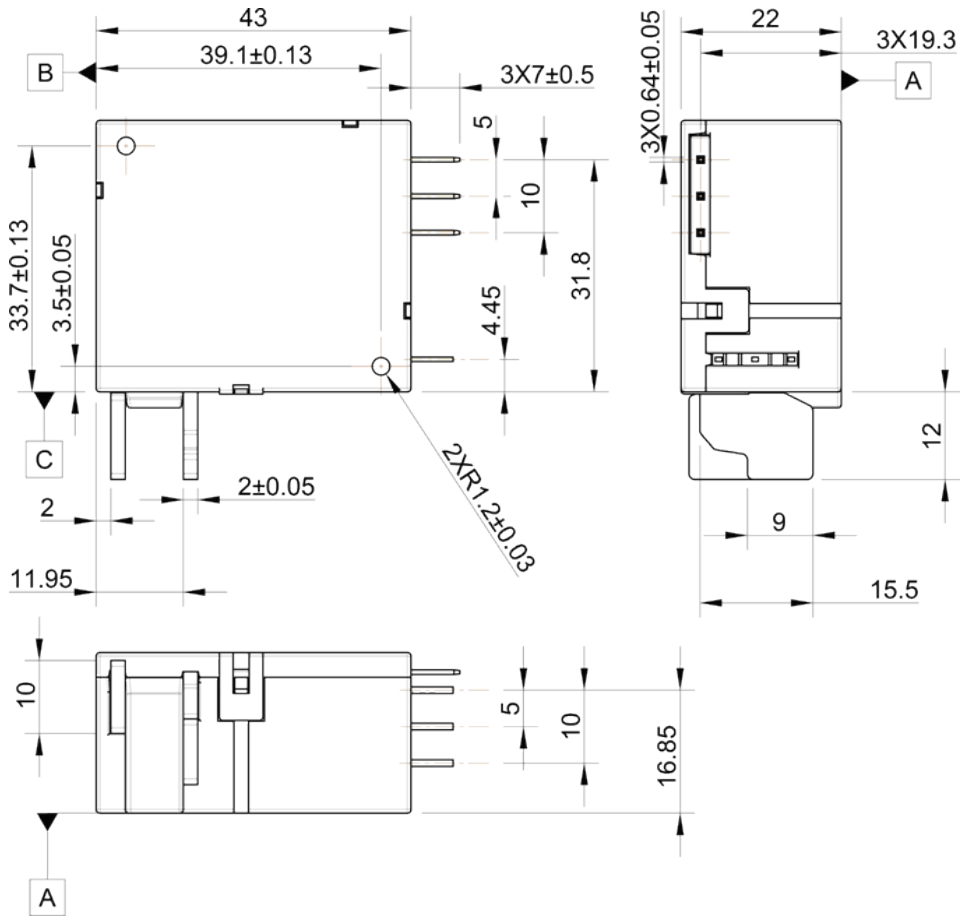

# Wiring Diagrams

**Single Coil**

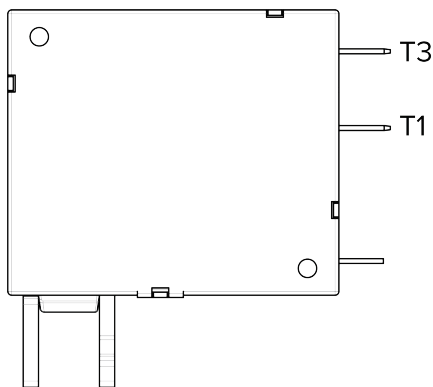

**Positive Polarity**

- Close +



+ Open -


**Negative Polarity**

+ Close -



- Open +

**Dual Coil**

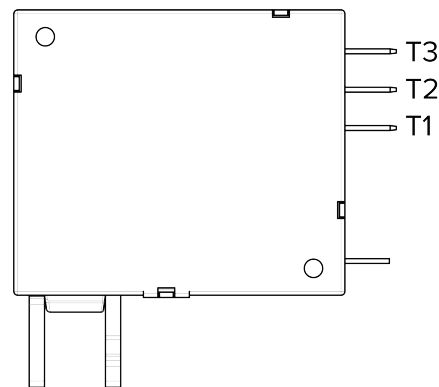

**Positive Polarity**

+ Open      Close +



- T2

**Negative Polarity**


- Open      Close -



+ T2

# Auxiliary Contacts §§

K127 ■ - ■ ■ ■ - ■ T 2 C-90 -Cxxxx

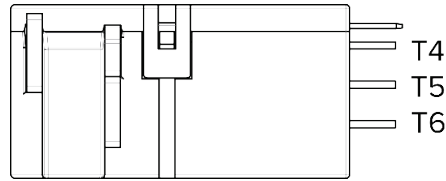

Auxiliary contact position (Load contacts Open)	Auxiliary contact position (Load contacts Closed)


§§ Durability Characteristics:

0.1A / 250Vac; Rated Load: 10,000 cycles; PF=1

No Load: 500,000 cycles

## Application Notes

1. It is possible that during transit or final assembly the relay could change state. Therefore, it is recommended that all relays be set to the desired state via a power supply.
2. In order to maintain an “Open” or “Closed” state of the relay, the coil voltage should reach the rated voltage. The pulse width should be 50ms minimum to ensure a proper change of state. DO NOT energize both T1 and T3 at the same time on a Dual Coil or energize the coil for longer than 1 minute (damage to the coil could occur).
3. Applying excessive heat to the relay terminals (soldering or welding) can cause damage to the internal structure of the relay and should be avoided.
4. Moving or bending the terminals can cause damage to the internal structure of the relay and should be avoided.
5. For definitions of terms used in this data sheet, see [glossary](http://www.kgtechnologies.net/glossary) at [www.kgtechnologies.net](http://www.kgtechnologies.net).



6028 State Farm Drive, Rohnert Park, CA 94928  
 Tel: +1.888.513.1874 Fax: +1.707.665.5966  
 Email: [techinfo@kgtechnologies.net](mailto:techinfo@kgtechnologies.net)  
[www.kgtechnologies.net](http://www.kgtechnologies.net)



Scan here for more information

**Disclaimer:** This datasheet is for reference only. All specifications are subject to change without prior notice. KG Technologies, Inc. cannot predict every possible application for our relays. While we do our best to make our relays as versatile as possible, we highly recommend contacting our engineering team if you have any questions. KG Technologies, Inc. is not responsible for malfunctioning relays when operated outside the specified parameters given in this datasheet.